

**TECHNICAL REPORT
ISA-TR18.2.4-2012**

**Enhanced and Advanced
Alarm Methods**

Approved 6 September 2012

ISA-TR18.2.4-2012, *Enhanced and Advanced Alarm Methods*

ISBN: 978-1-937560-19-5

Copyright © 2012 by the International Society of Automation. All rights reserved. Printed in the United States of America. No part of this publication may be reproduced, stored in a retrieval system, or transmitted in any form or by any means (electronic, mechanical, photocopying, recording, or otherwise), without the prior written permission of the publisher.

ISA
67 Alexander Drive
P.O. Box 12277
Research Triangle Park, North Carolina 27709
E-mail: standards@isa.org

Preface

This preface, as well as all footnotes, is included for information purposes only and is not part of ISA-TR18.2.4-2012.

This technical report has been prepared as part of the service of ISA, the International Society of Automation, toward a goal of helping in the understanding and use of ANSI/ISA-18.2-2009, *Management of Alarm Systems for the Process Industries*. To be of real value, this document should not be static but should be subject to periodic review. Toward this end, the Society welcomes all comments and criticisms and asks that they be addressed to the Secretary, Standards and Practices Board; ISA, 67 Alexander Drive; P.O. Box 12277; Research Triangle Park, NC 27709; Telephone (919) 549-8411; Fax (919) 549-8288; E-mail: standards@isa.org.

The ISA Standards and Practices Department is aware of the growing need for attention to the metric system of units in general, and the International System of Units (SI) in particular, in the preparation of instrumentation standards, recommended practices, and technical reports. The Department is further aware of the benefits of USA users of ISA standards of incorporating suitable references to the SI (and the metric system) in their business and professional dealings with other countries. Toward this end, this Department will endeavor to introduce SI-acceptable metric units in all new and revised standards, recommended practices, and technical reports to the greatest extent possible. *Standard for Use of the International System of Units (SI): The Modern Metric System*, published by the American Society for Testing & Materials as IEEE/ASTM SI 10-97, and future revisions, will be the reference guide for definitions, symbols, abbreviations, and conversion factors.

It is the policy of ISA to encourage and welcome the participation of all concerned individuals and interests in the development of ISA standards. Participation in the ISA standards-making process by an individual in no way constitutes endorsement by the employer of that individual, of ISA, or of any of the standards, recommended practices, and technical reports that ISA develops.

CAUTION — ISA DOES NOT TAKE ANY POSITION WITH RESPECT TO THE EXISTENCE OR VALIDITY OF ANY PATENT RIGHTS ASSERTED IN CONNECTION WITH THIS DOCUMENT, AND ISA DISCLAIMS LIABILITY FOR THE INFRINGEMENT OF ANY PATENT RESULTING FROM THE USE OF THIS DOCUMENT. USERS ARE ADVISED THAT DETERMINATION OF THE VALIDITY OF ANY PATENT RIGHTS, AND THE RISK OF INFRINGEMENT OF SUCH RIGHTS, IS ENTIRELY THEIR OWN RESPONSIBILITY.

PURSUANT TO ISA'S PATENT POLICY, ONE OR MORE PATENT HOLDERS OR PATENT APPLICANTS MAY HAVE DISCLOSED PATENTS THAT COULD BE INFRINGED BY USE OF THIS DOCUMENT AND EXECUTED A LETTER OF ASSURANCE COMMITTING TO THE GRANTING OF A LICENSE ON A WORLDWIDE, NON-DISCRIMINATORY BASIS, WITH A FAIR AND REASONABLE ROYALTY RATE AND FAIR AND REASONABLE TERMS AND CONDITIONS. FOR MORE INFORMATION ON SUCH DISCLOSURES AND LETTERS OF ASSURANCE, CONTACT ISA OR VISIT WWW.ISA.ORG/STANDARDSPATENTS.

OTHER PATENTS OR PATENT CLAIMS MAY EXIST FOR WHICH A DISCLOSURE OR LETTER OF ASSURANCE HAS NOT BEEN RECEIVED. ISA IS NOT RESPONSIBLE FOR IDENTIFYING PATENTS OR PATENT APPLICATIONS FOR WHICH A LICENSE MAY BE REQUIRED, FOR CONDUCTING INQUIRIES INTO THE LEGAL VALIDITY OR SCOPE OF PATENTS, OR DETERMINING WHETHER ANY LICENSING TERMS OR CONDITIONS PROVIDED IN CONNECTION WITH SUBMISSION OF A LETTER OF ASSURANCE, IF ANY, OR IN ANY LICENSING AGREEMENTS ARE REASONABLE OR NON-DISCRIMINATORY.

ISA REQUESTS THAT ANYONE REVIEWING THIS DOCUMENT WHO IS AWARE OF ANY PATENTS THAT MAY IMPACT IMPLEMENTATION OF THE DOCUMENT NOTIFY THE ISA STANDARDS AND PRACTICES DEPARTMENT OF THE PATENT AND ITS OWNER.

ADDITIONALLY, THE USE OF THIS DOCUMENT MAY INVOLVE HAZARDOUS MATERIALS, OR EQUIPMENT. THE DOCUMENT CANNOT ANTICIPATE ALL POSSIBLE APPLICATIONS OR ADDRESS ALL POSSIBLE SAFETY ISSUES ASSOCIATED WITH USE IN HAZARDOUS CONDITIONS. THE USER OF THIS DOCUMENT MUST EXERCISE SOUND PROFESSIONAL JUDGMENT CONCERNING ITS USE AND APPLICABILITY UNDER THE USER'S PARTICULAR CIRCUMSTANCES. THE USER MUST ALSO CONSIDER THE APPLICABILITY OF ANY GOVERNMENTAL REGULATORY LIMITATIONS AND ESTABLISHED SAFETY AND HEALTH PRACTICES BEFORE IMPLEMENTING THIS DOCUMENT.

THE USER OF THIS DOCUMENT SHOULD BE AWARE THAT THIS DOCUMENT MAY BE IMPACTED BY ELECTRONIC SECURITY ISSUES. THE COMMITTEE HAS NOT YET ADDRESSED THE POTENTIAL ISSUES IN THIS VERSION.

The following people served as members of ISA18 Working Group 4 and contributed to this technical report:

NAME	COMPANY
Joe Alford	Joseph S. Alford, LLC
Michael Carter	GE Energy
Lieven Dubois	UReason
Bill Hollifield	PAS
Robert Hudson	Shell Global Solutions
John Huhman	Shell Global Solutions
Darwin Logerot	ProSys Inc.
Doug Metzger	Consultant
Mike Miller	Shell Global Solutions
Graham Nasby	Eramosa Engineering Inc.
Nick Sands	DuPont
Rainer Spies	SpiraTec AG
Kim VanCamp	Emerson Process Management
Bob Weibel	Tips Inc.

The following people served as voting members of ISA18 and contributed to this technical report:

NAME	COMPANY
Donald Dunn, Co-Chair	Aramco Services Co.
Nicholas Sands, Co-Chair	DuPont
Erwin Icyan	ACES Inc.
Joseph Alford	Joseph S. Alford LLC
Stephen Apple	IntelaTrac-Wonderware Mobile Solutions
Joe Bingham	AES Global Inc.
Alex Boquiren	Bechtel Corp.
Alan Bryant	Oxy Inc.
John Campbell	Consultant
Bridget Fitzpatrick	Mustang Engineering
Max Hanson	MCC Control Systems
Bill Hollifield	PAS
Alan Hugo	Capstone Technology
Lokesh Kalra	Chevron
Edward Marszal	Kenexis
Michael Marvan	Shell Canada

Douglas Metzger
 Ian Nimmo
 Patrick O'Donnell
 Douglas Rothenberg
 Todd Stauffer
 David Strobhar
 Angela Summers
 Beth Vail
 Bob Weibel

DPM Consulting
 User Centered Design Services LLC
 BP
 D. Roth Inc.
 Exida Co.
 Beville Engineering Inc.
 SIS-TECH Solutions LP
 URS SMS
 TiPs Inc.

This technical report was approved for publication by the ISA Standards and Practices Board on 6 September 2012.

NAME

D. Dunn, Vice President
 E. Cosman, Vice President-Elect
 D. Bartusiak
 P. Brett
 J. Campbell
 M. Coppler
 B. Dumortier
 J. Federlein
 J. Gilsinn
 E. Icyan
 J. Jamison
 K. Lindner
 V. Maggioli
 T. McAviney
 R. Reimer
 S. Russell
 N. Sands
 H. Sasajima
 T. Schnaare
 J. Tatera
 I. Verhappen
 W. Weidman
 J. Weiss
 M. Wilkins
 D. Zetterberg

COMPANY

Aramco Services Co.
 The Dow Chemical Co.
 ExxonMobil Chemical Company
 Honeywell Inc.
 Consultant
 Det Norske Veritas Certification Inc.
 Consultant
 Federlein & Assoc. Inc.
 Kenexis Consulting Group
 ACES Inc.
 EnCana Corporation Ltd.
 Endress+Hauser Process Solutions AG
 Feltronics Corp.
 Instrumentation & Control Engineering LLC
 Rockwell Automation
 Valero Energy Corp.
 DuPont
 Azbil Corp.
 Rosemount Inc.
 Tatera & Associates Inc.
 Yokogawa Canada Inc.
 WCW Consulting
 Applied Control Solutions LLC
 Yokogawa IA Global Marketing USMK
 Chevron Energy Technology Company

The page intentionally left blank.

Contents

Foreword	9
Introduction	10
1 Scope	13
1.1 Exclusions	13
2 Normative references	14
3 Definition of terms and acronyms	14
3.1 Definitions	14
3.2 Acronyms	17
4 Considerations in the application of enhanced and advanced alarming methods	18
4.1 Enhanced and advanced alarm methods vs. basic alarm methods	18
4.2 Potential added complexity and cost	18
5 Information linking	19
5.1 Purpose	19
5.2 Applicable examples needing information linking	19
5.3 Information linking sources	20
5.4 Linking interfaces	22
5.5 Alarm systems linked with manufacturing operations management (MOM)	24
6 State-based alarming	25
6.1 Purpose	25
6.2 Technique: First-out alarming case	26
6.3 Technique: Designed alarm suppression	27
6.4 Technique: State-driven alarm attribute changes	28
6.5 Application: One or more alarms, minor equipment	32
6.6 Application: Multiple alarms, major equipment	32
6.7 Application: Complex equipment trip and flood suppression	33
6.8 Application: Trip does not proceed normally	33
6.9 Application: Utilizing multiple sources of information	34
6.10 Technique: Continuously calculated alarm setpoints	35
7 Dynamic cause analysis and guidance	36
7.1 Purpose	36
7.2 The HMI and abnormal situation cause determination	36
7.3 Challenges in online determination of an abnormal situation cause	37
7.4 Techniques available to assist in cause determination	39
7.5 Challenges in providing alarm response guidance to operators	43
8 Alarm routing and escalation	45
8.1 Purpose	45
8.2 Basic alarm routing	45
8.3 Enhanced alarm routing	46
8.4 Enhanced hardware capabilities	47
8.5 Re-alarming and alarm escalation	47

9	Use of alerts	48
9.1	Purpose	48
9.2	Problems and opportunities.....	48
9.3	Understanding alerts	48
9.4	Operator adjustment of alarm setpoints.....	50
9.5	Operator alert characteristics	50
10	Advanced alarming relative to batch and discrete operations	51
10.1	Purpose	51
10.2	Applicability to batch processes	51
10.3	Applicability to discrete processes	52
11	Work process and preservation of alarm integrity	52
11.1	Purpose	52
11.2	Alarm philosophy stage and alarm system requirements specification	52
11.3	Rationalization, design, operation, maintenance, monitoring and assessment stages	53
11.4	Alarm enforcement.....	53
11.5	Management of change (MOC)	53
11.6	Training	54
12	References	54
13	Bibliography	54

Figures

Figure 1	– Alarm management lifecycle (ISA-18.2)	10
Figure 2	– Solution space pattern diagram for successful vs. unsuccessful tablet coating runs	36
Figure 3	– Fishbone cause-effect diagram for a pH alarm	40
Figure 4	– Neural net cause-effect diagram	41
Figure 5	– Decision tree regarding batch success.....	43
Figure 6	– Sample criteria for notification types from an alarm philosophy	49
Figure 7	– Examples of operator notifications from an example alarm philosophy	49

Foreword

In 2009, ANSI/ISA-18.2-2009, *Management of Alarm Systems for the Process Industries*, commonly referred to as ISA-18.2, was issued. In that same year the ISA18 committee established working groups to develop a series of technical reports with guidance on how to implement the practices outlined in ISA-18.2. The six independent technical reports are described below:


- ISA-dTR18.2.1, *Alarm Philosophy* [dTR1], provides guidance on the alarm philosophy and is limited to the scope of Clause 6 in ISA-18.2. The alarm philosophy provides guidance for successful management of the alarm system. It covers the definitions, principles, and activities by providing overall guidance on methods for alarm identification, rationalization, classification, prioritization, monitoring, management of change, and audit. (As of the publication of this technical report, the draft, dTR1, had not been published.)
- ISA-dTR18.2.2, *Alarm Identification and Rationalization* [dTR2], provides guidance on alarm identification and rationalization and is limited to the scope of Clauses 8 and 9 in ISA-18.2. Identification and rationalization cover the activities to determine the possible need for an alarm or a change to an alarm; systematically compare alarms to the alarm philosophy; and determine the alarm setpoint, consequence, operator action, priority, and class. Activities include, but are not limited to, identification, justification, prioritization, classification, and documentation. (As of the publication of this technical report, the draft, dTR2, had not been published.)
- ISA-dTR18.2.3, *Basic Alarm Design* [dTR3], provides guidance on basic alarm design, focuses on the scope of Clause 10 of ISA-18.2, and may include other clauses as needed (e.g., Clause 14 on operations and Clause 15 on maintenance). Basic alarm design covers the selection of alarm attributes (e.g., types, deadbands, and delay times) and may be specific to each control system. (As of the publication of this technical report, the draft, dTR3, had not been published.)
- ISA-TR18.2.4-2012, *Enhanced and Advanced Alarm Methods* [TR4], provides guidance on enhanced and advanced alarm methods and focuses on the scope of Clause 12 of ISA-18.2. Enhanced alarm design covers guidance on additional logic, programming, or modeling used to modify alarm behavior. These methods may include: dynamic alarming, state-based alarming, adaptive alarms, logic-based alarming, and predictive alarming, as well as most of the designed suppression methods.
- ISA-TR18.2.5-2012, *Alarm System Monitoring, Assessment, and Auditing* [TR5], provides guidance on monitoring, assessment and audit of alarms and focuses on the scope of Clauses 16 and 18 in ISA-18.2. Monitoring, assessment, and audit cover the continuous monitoring, periodic performance assessment, and recurring audit of the alarm system.
- ISA-TR18.2.6-2012, *Alarm Systems for Batch and Discrete Processes* [TR6], provides guidance on the application of ISA-18.2 alarm lifecycle activities to batch and discrete processes, expanding on multiple clauses of ISA-18.2.

The guidance as presented in this document is general in nature and should be applied to each system as appropriate by personnel knowledgeable in the manufacturing process and control systems to which it is being applied. This guidance will evolve with experience and technology advancements.

Introduction

Alarm management lifecycle

ISA-18.2 gives requirements that address alarm systems for facilities in the process industries to improve safety, quality, and productivity. The general principles and processes in ISA-18.2 are intended for use in the lifecycle management of an alarm system based on programmable electronic controller- and computer-based human machine interface (HMI) technology. These requirements are presented in the standard, using the alarm management lifecycle shown in ISA-18.2.

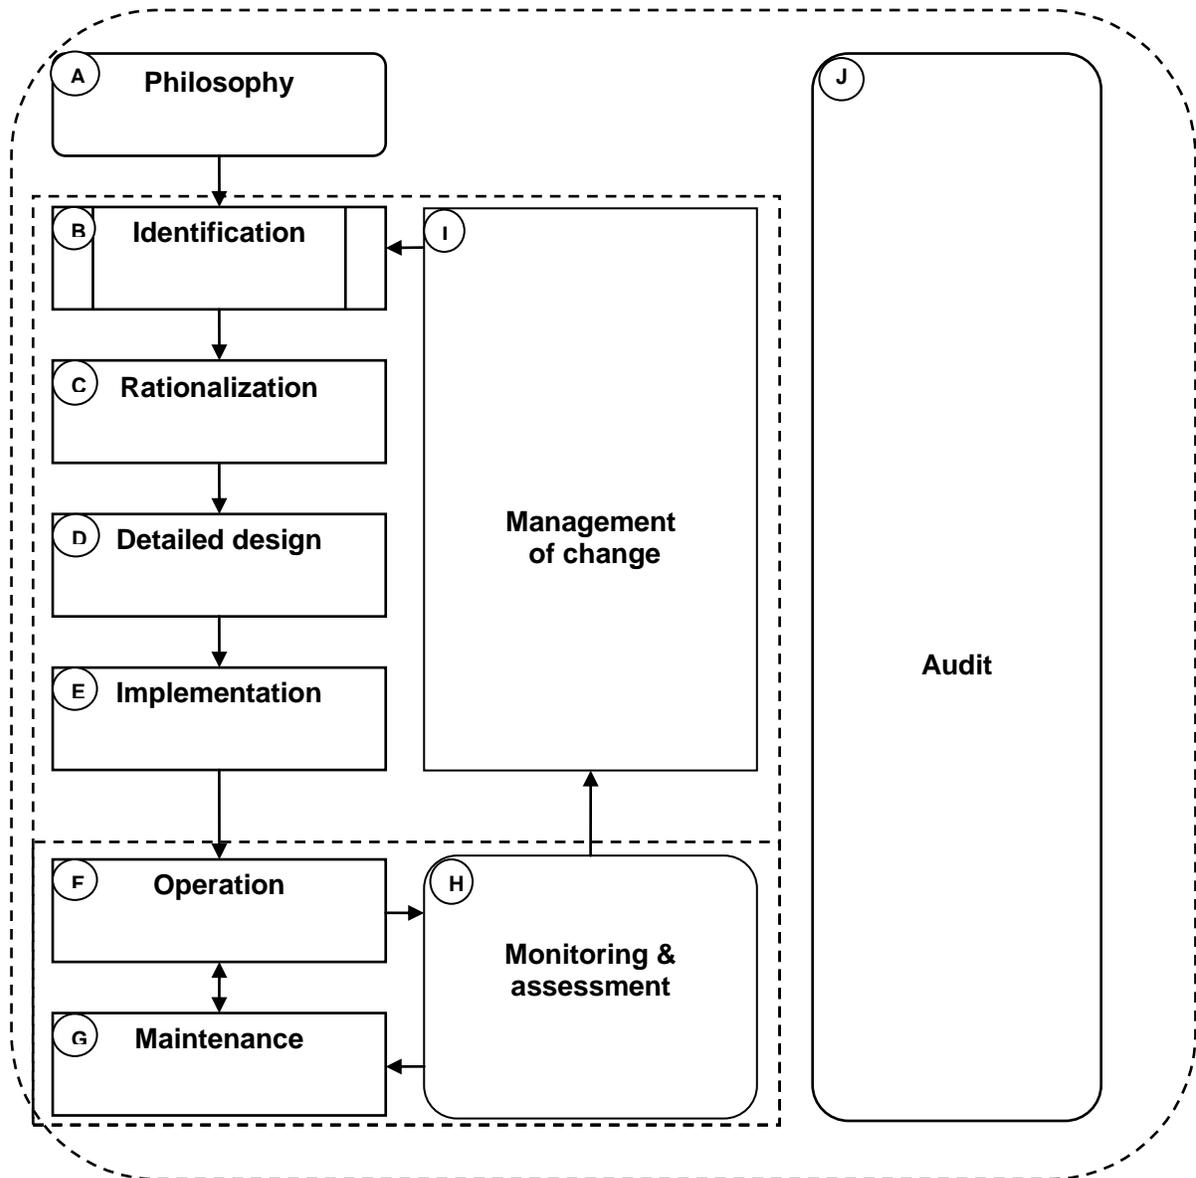

Note 1: The box used for stage B represents a process defined outside of ISA-18.2.

Note 2: The independent stage J represents a process that connects to all other lifecycle stages.

Note 3: The rounded shapes of stages A, H, and J represent entry points to the lifecycle.

Note 4: The dotted lines represent the loops in the lifecycle.

Figure 1 – Alarm management lifecycle (ISA-18.2)

Enhanced and advanced alarming

Clause 12 of ISA-18.2 discusses enhanced and advanced alarm methods. These methods typically go beyond the basic methods and techniques that are usually, or at least initially, applied. It is an informative clause and contains no mandatory requirements. Enhanced and advanced alarming is not a separate stage in the alarm management lifecycle, a separate work process, or a specific application. It is a collection of methods and techniques that can be applied within the ISA-18.2 lifecycle stages. For example, advanced alarming techniques on specific alarms are designed in the ISA-18.2 design stage and implemented in the implementation stage. Significant improvement in alarm system function and performance can usually be made by following the basic alarming methods and principles. However, in many cases they may not be sufficient to achieve the goals for performance and operator guidance stated in the alarm philosophy. For example, due to changing process or equipment state, the alarms may not always trigger at the appropriate times for operator action, or they may trigger at times when no action is needed.

Enhanced and advanced alarming methods are additional layers of logic, programming, modeling, or a combination thereof, used to modify alarm behavior or to improve operator guidance to better meet the objectives of an alarm system.

Purpose of this technical report

The purpose of this technical report is to help people evaluate when to use enhanced and advanced alarming methods, what benefits they can achieve, and what challenges and costs to expect. The objectives of this technical report are:

- a) to educate plant personnel as to what solutions are possible when the basic alarming methods alone do not achieve a site's alarm management objectives
- b) to help plant personnel to identify potential benefits, costs, risks, and necessary follow-up for solutions at their sites; to help decide whether or not they should consider enhanced and advanced alarming techniques; and if so, which specific techniques should be incorporated into their alarm philosophy and work processes
- c) to help those involved in the design, procurement, implementation, maintenance, and operation of enhanced and advanced alarming methods, for both existing systems and new systems
- d) to provide guidance and examples to help ensure successful deployment of the solutions

Report organization

Clause 12 of ISA-18.2 divides enhanced and advanced alarming into four categories based on type of solution: information linking, logic-based alarming, model-based alarming, and additional alarming considerations.

This technical report is organized by type of alarming problem, rather than by solution technique. The intent is to cover all the techniques but to cover them in the context of the site problems that they address. Some techniques can be used to address multiple problems, and in the more complex problems and solutions, multiple techniques may be used, as shown in some of the examples of this report.

The technical report is organized as follows:

Clause 1 discusses the scope of this technical report, including important exclusions.

Clause 2 gives normative references.

Clause 3 provides definitions of terms and acronyms used in this technical report, most of which are defined in ISA-18.2 and used here.

Clause 4 discusses the primary differences between enhanced/advanced alarming methods and basic alarming methods, including discussion of situations that may lead to the need for enhanced and advanced methods.

Clauses 5 through 10 provide guidance and examples for using enhanced or advanced alarming methods to solve alarm system problems that remain after application of the basic alarming techniques. The problems, with their solutions, are presented roughly in their order of complexity.

Clause 5 discusses situations in which the information embedded in the alarm itself may not be enough to guide the operator to appropriate action. Often the appropriate guidance has already been identified during the rationalization stage. This clause discusses information linking techniques, such as those for presenting this and other guidance to operators at the appropriate times.

Clause 6 discusses situations in which changing plant operating conditions may lead to the need for advanced methods, such as designed suppression or changing alarm attributes, in order for the alarm system to properly track the changing states of the process. This can occur for planned operating states, such as start-up, shutdown, and different feedstocks; or it can occur due to unplanned events, such as a compressor trip.

Clause 7 builds upon this discussion. In some cases, the dynamic alarming methods of Clause 6 still do not provide adequate operator guidance, and enhancements may be needed to provide appropriate guidance for all anticipated process situations. Clause 7 discusses utilization of dynamic cause analysis to provide more tailored operator guidance in such situations.

Clause 8 discusses situations in which the basic alarm system alone does not deliver the alarm to the person (i.e., role) on the operating team who (based on the operating philosophy) should react to the alarm. In some situations, the responder is not in the control room or is in the control room but at a different console due to process dynamics, scheduling, or other competing plant floor activities. This clause discusses these issues and related solutions.

Clause 9 discusses appropriate use of alerts. As identified in ISA-18.2, alerts share some of the same characteristics but do not meet all of the criteria of alarms. Though they are not alarms, the use of alerts relative to alarms is important and is discussed in this clause.

Clause 10 briefly discusses the use of enhanced/advanced alarming methods for batch and discrete processes. These methods are more broadly covered in TR6.

Clause 11 discusses how the alarm system integrity is maintained through appropriate application of site work processes, including those discussed in ISA-18.2. If appropriate care is not taken in the application of the enhanced and advanced methods presented here, loss of alarm integrity and other problems can result.

Clauses 12 and 13 provide a list of references and a bibliography.